


TEPLOTY PRIMÁRNÝCH ROZVODOV (MH Teplárenský holding a.s., závod Žilina)

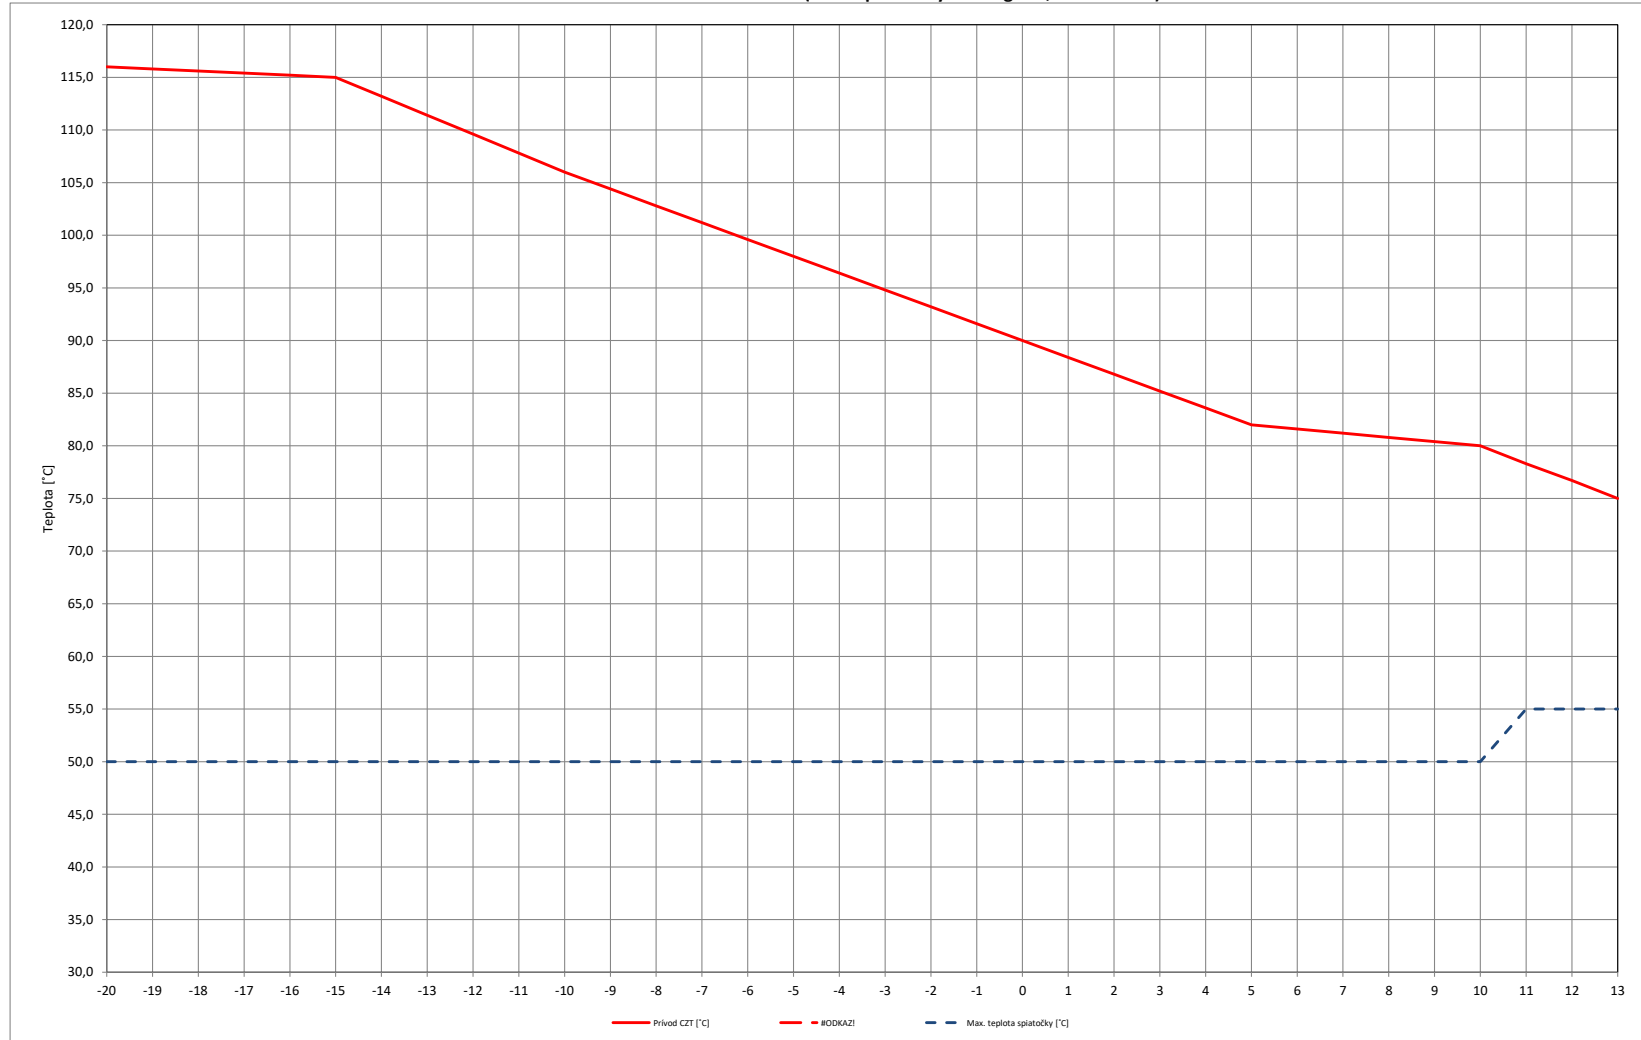

| Vonkajšia teplota t_e [°C] | -20 | -19 | -18 | -17 | -16 | -15 | -14 | -13 | -12 | -11 | -10 | -9 | -8 | -7 | -6 | -5 | -4 | -3 | -2 | -1 | 0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 |
|------------------------------|-------|-------|--------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|------|------|
| Prívod CZT [°C] | 116,0 | 115,8 | 115,6 | 115,4 | 115,2 | 115,0 | 113,2 | 111,4 | 109,6 | 107,8 | 106,0 | 104,4 | 102,8 | 101,2 | 99,6 | 98,0 | 96,4 | 94,8 | 93,2 | 91,6 | 90,0 | 88,4 | 86,8 | 85,2 | 83,6 | 82,0 | 81,6 | 81,2 | 80,8 | 80,4 | 80,0 | 78,3 | 76,7 | 75,0 |
| Max. teplota spätočky [°C] | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 50,0 | 55,0 | 55,0 | 55,0 | |