


TEPLOTY PRIMÁRNYCH ROZVODOV (MH Teplárenský holding a.s., závod Zvolen)

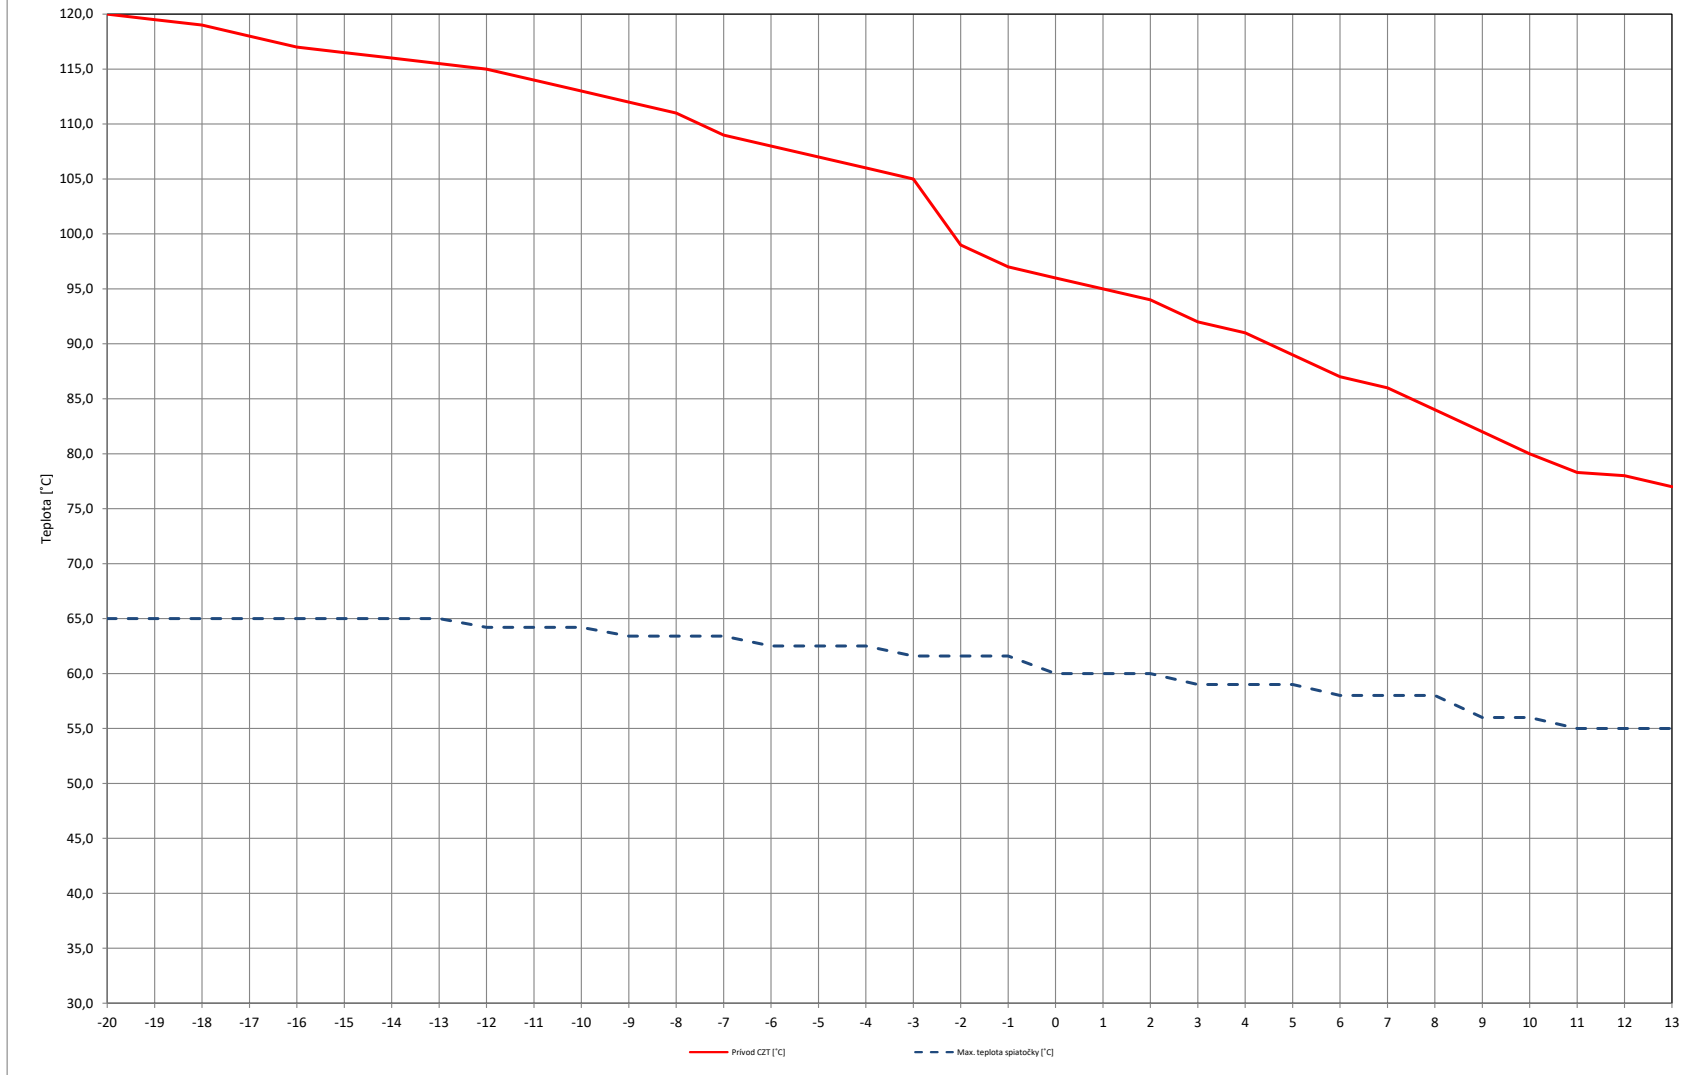

Vonkajšia teplota t _e [°C]	-20	-19	-18	-17	-16	-15	-14	-13	-12	-11	-10	-9	-8	-7	-6	-5	-4	-3	-2	-1	0	1	2	3	4	5	6	7	8	9	10	11	12	13
Privod CZT [°C]	120,0	119,5	119,0	118,0	117,0	116,5	116,0	115,5	115,0	114,0	113,0	112,0	111,0	109,0	108,0	107,0	106,0	105,0	99,0	97,0	96,0	95,0	94,0	92,0	91,0	89,0	87,0	86,0	84,0	82,0	80,0	78,3	78,0	77,0
Max. teplota	65,0	65,0	65,0	65,0	65,0	65,0	65,0	65,0	64,2	64,2	64,2	63,4	63,4	63,4	62,5	62,5	62,5	61,6	61,6	61,6	60,0	60,0	60,0	59,0	59,0	59,0	58,0	58,0	58,0	56,0	56,0	55,0	55,0	55,0